

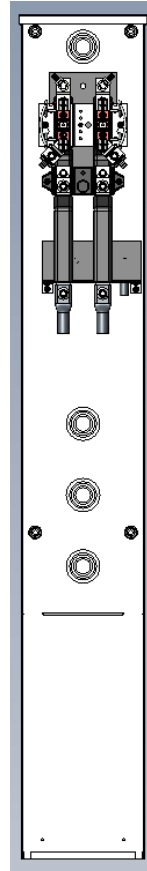


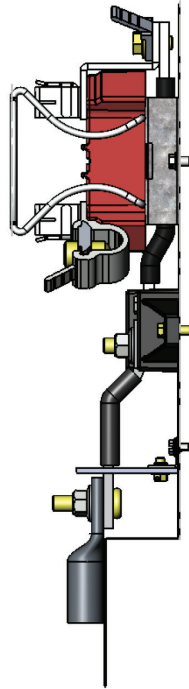



MILBANK
ENERGY AT WORK

K6165 & K6165-EX

*Frost Heaving Interior Replacement Kit for
U8436-O-CECHA*

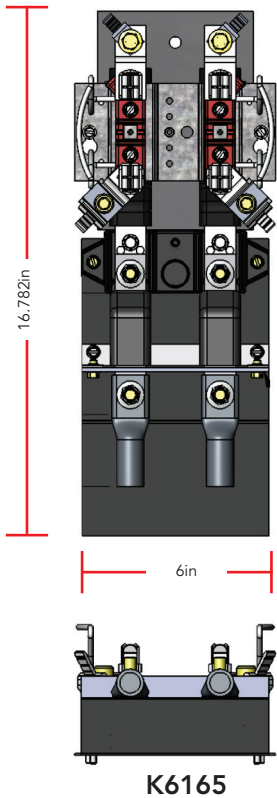

U8436-O-CECHA
with K6165-EX installed

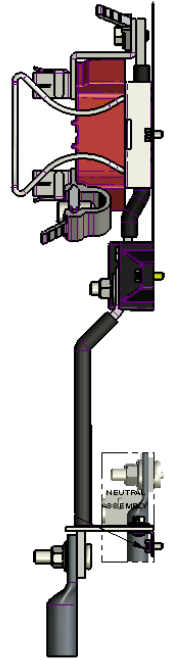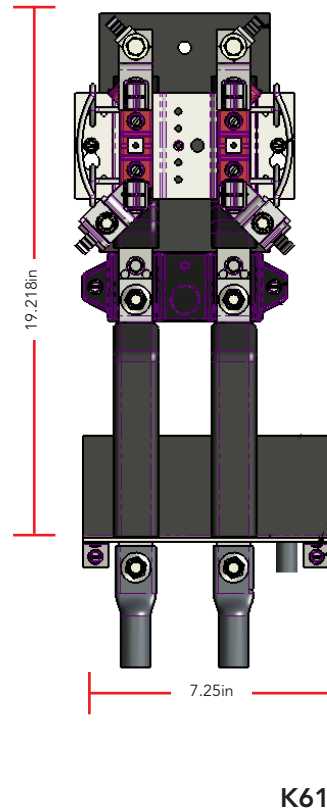

Specifications

- **K6165** is XXXX length.
- **K6165-EX** is XXX length.
- Kits come with new insulating barrier between the block and the shell, and between the netrueal lug and the line lugs.
- Designed with extended bussing to accomodate line side wires affected by frost heaving.

Please consult serving utility for their requirements prior to ordering or installing, as specifications and approvals vary by utility, and may require local electrical inspector approval. All installations must be installed by a licensed electrician and must comply with all national and local codes, laws and regulations. Milbank reserves the right to make changes in specifications and features shown without notice or obligation.

